

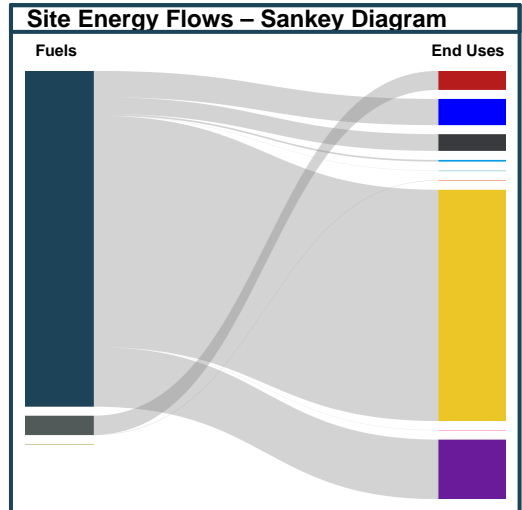
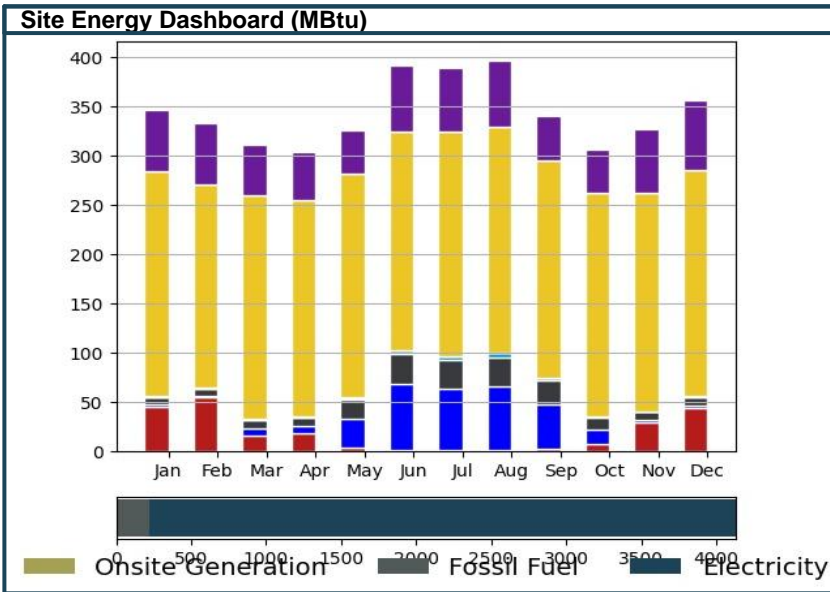


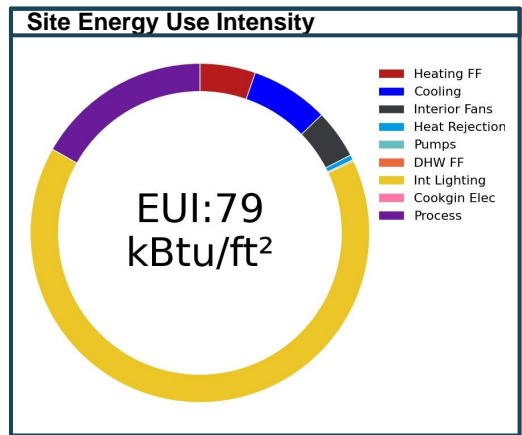

<b>Project:</b>	CASR Baseline
<b>Address:</b>	
<b>Climate File:</b>	USA_CO_Denver_Intl_AP_725650_TMY3.epw
<b>Simulation:</b>	Sample Project_CASR_12-19-22 CTE.aps

<b>Design Team:</b>	
<b>Energy Analyst:</b>	
<b>Owner:</b>	
<b>Conditioned Area (ft²):</b>	52050.0000

Annual Energy Consumption (kBtu/ft²/year) & CO2 KgCO2/ft²/yr				
Energy End Use	Site Energy	Source Energy	CO2 Emissions	
Heating Fossil Fuel	4.2	4.8	0.3	
Heating Electricity	0.0	0.0	0.0	
Space Cooling	5.9	9.0	0.3	
Fans Interior	3.7	5.7	0.2	
Heat Rejection	0.4	0.6	0.0	
Pumps	0.0	0.0	0.0	
DHW Fossil Fuel	0.1	0.1	0.0	
DHW Electricity	0.0	0.0	0.0	
Interior Lighting	51.7	79.3	2.2	
Exterior Lighting	0.0	0.0	0.0	
Receptacle	0.0	0.0	0.0	
Data Center	0.0	0.0	0.0	
Cooking Fossil Fuel	0.0	0.0	0.0	
Cooking Electricity	0.0	0.0	0.0	
Elevators & Escalators	0.0	0.0	0.0	
Refrigeration	0.0	0.0	0.0	
Process	13.3	19.9	0.6	
<b>TOTAL (ex renewables)</b>	<b>79</b>	<b>119</b>	<b>3</b>	

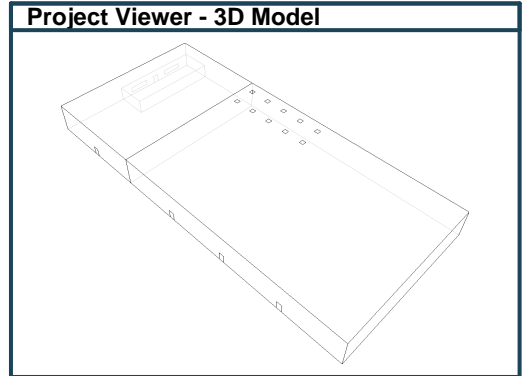

Annual Fuel Costs and Peak Demands				
Fuels	Cost (£)	Peak Day	Peak Time	Peak Demand
Electricity	80,959.00	14-Jun	16:00	329.6 kW
Fossil Fuel	1,942.00	02-Jan	0:00	586.3 kBtu/h
<b>Total</b>	<b>82,901.00</b>	<b>14-Jun</b>	<b>16:00</b>	

